



## EXTRACTS FROM APPROVED DOCUMENT B - THE BUILDING REGULATIONS 1991 (2000 EDITION)

### Case 1

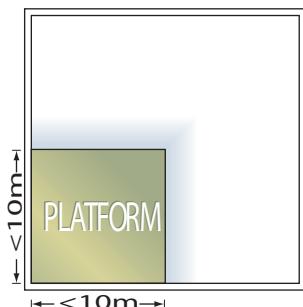


No protection required (as conditions opposite)

### Case 2

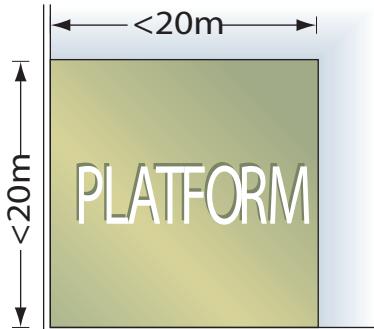

Smoke detection and alarm to the lower level  
- required standard L3 to BS 5829: Pt 1  
(as conditions opposite)

### Case 3

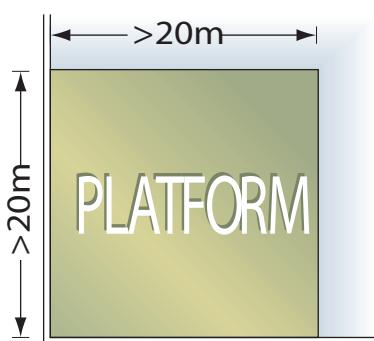

Sprinklers or fire resistance (as conditions opposite)

### 8.9 CONDITIONS TO SATISFY

- a. The structure has only one tier and is used for storage purposes only;
- b. The number of persons likely to be on the floor at any one time is low and does not include members of the public;
- c. The floor is not more than 10m in either width or length and does not exceed one half of the floor area of the space in which it is situated;
- d. The floor is open above and below to the room or space in which it is situated; and
- e. The means of escape from the floor meets the relevant provisions in Section 4, 5 and 6 of B1 - horizontal escape

**Table 3** Limitations on travel distance

Maximum travel distance where travel is possible:

	one direction only (m)	more than one direction (m)
Storage	25	45

If storage layout unknown take as two thirds of the travel distance